

N / 11-1654 / F

UNSCANNED



SOAKAWAY OR SPREADERS
AS DEEMED SUITABLE FOR
PERCOLATION TEST.
(100 CUBIC METRES IF
SOAKAWAY.)

EXISTING SEPTIC TANKS(2)
CAPACITY 6000 LTRS EACH.

NEW SEPTIC TANK
CAPACITY 6000 LTRS.

225 ϕ PIPEWORK.

FALLS NOT TO EXCEED 1:100

FALL NOT TO EXCEED 1:100.

MH2

MH3

225 ϕ
PIPEWORK

TOILET
BLOCK.

225 ϕ
PIPEWORK

200 ϕ PIPEWORK.

150 ϕ PIPEWORK

MH1

NOTE.


RODDING ACCESS POINTS TO
BE FITTED AT INTERSECTION POINTS.

HEREFORDSHIRE COUNCIL
PLANNING SERVICES
DEVELOPMENT CONTROL

08 AUG 2011

To: _____

Ack'd: _____ File: _____

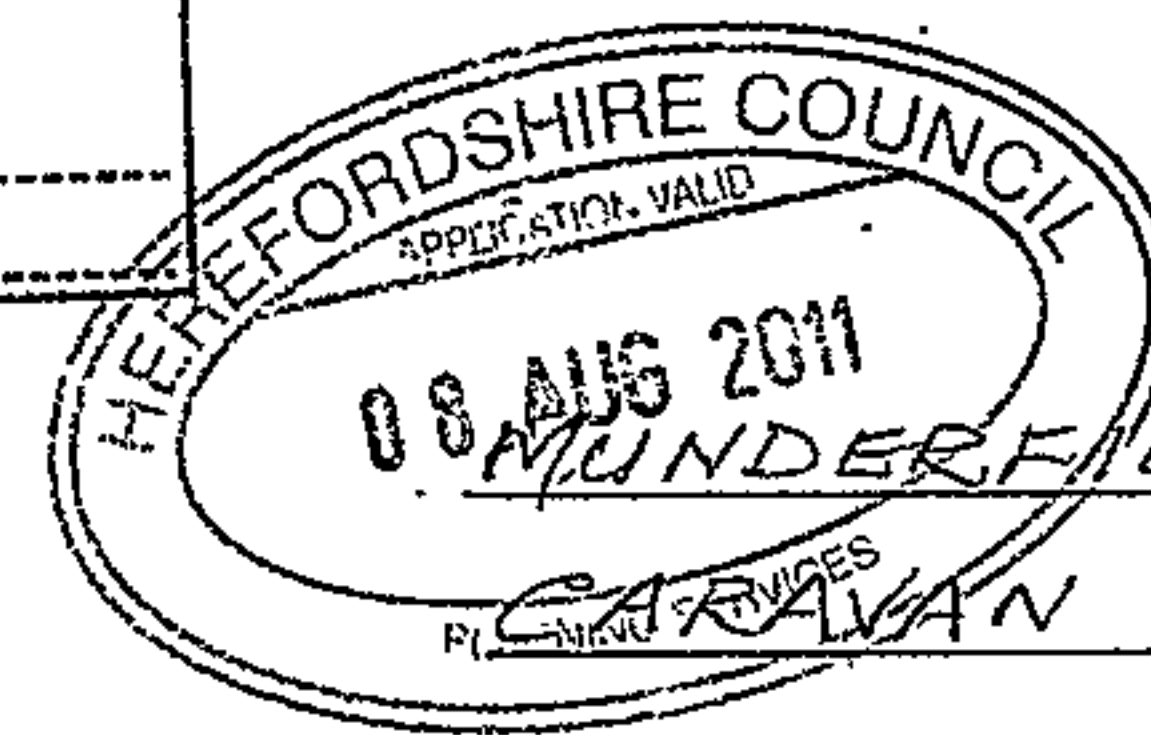

PROPOSED F.W. SYSTEM.

SCALE 1:500

08 AUG 2011

MUNDERFIELD HAROLD

PLANNING SERVICES
CARAVAN SITE