


Clifford Hall  
pv. Solar panels S / 111528 / F  
PP-01510465

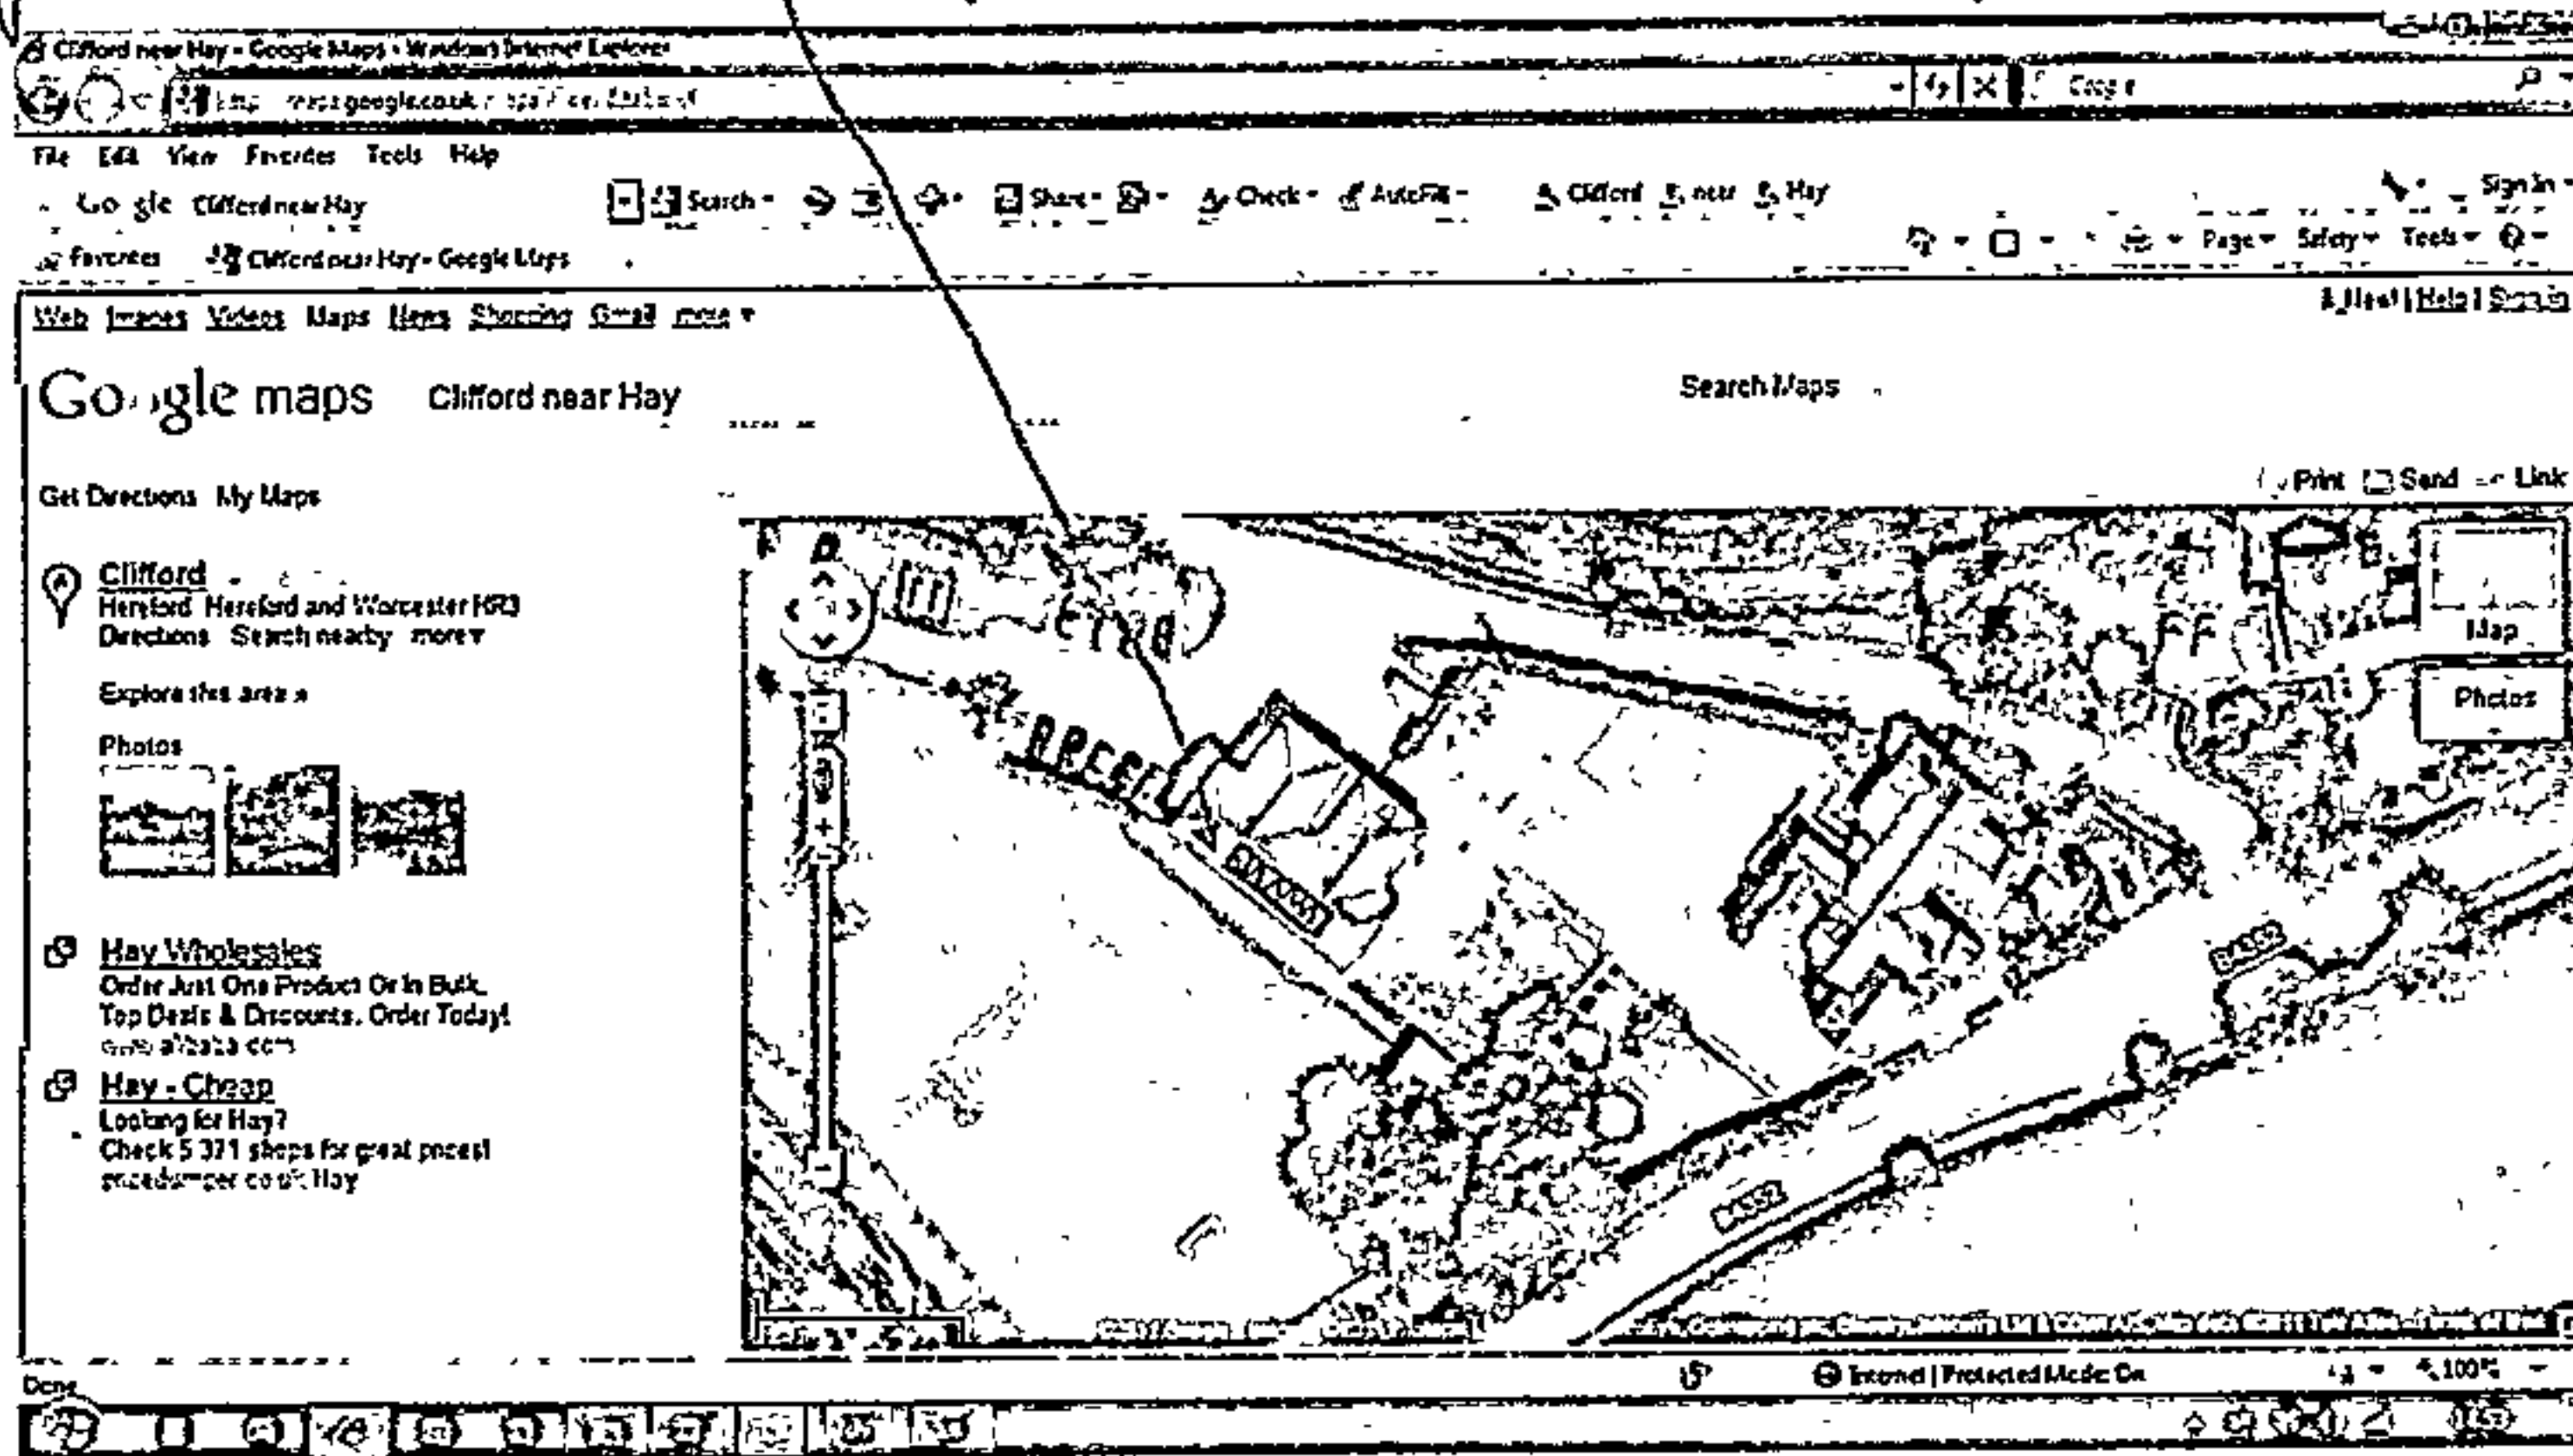

See the attached drawing showing the proposed layout.

### Connection to grid

The system will be connected to the local grid via your distribution board. As the system is greater than 16 Amp in output, a connection agreement will be required with the local Distribution Network Operator. This will be done as part of the work carried out by Greenearth Energy Ltd. The quote is based on this connection being granted under G83. If this is not granted and a G59 connection is requested by the Distribution Network Operator, this will incur additional costs which are not included for in this quote.

### Electrical inspection and testing

As part of the installation we are required to carry out an electrical test of the work carried out and an inspection of the electrical protection components in your existing electrical system. We assume for the purposes of this quote that your existing electrical installation complies with current regulations. Any works required to bring the installation up to this standard should be done in advance of the proposed work quoted here. Greenearth Energy Ltd. is NICEIC approved.

<p>RECEIVED BY THE OFFICE OF PLANNING SERVICES DEVELOPMENT CONTROL</p> <p>13 JAN 2011</p> <p>Tel: 01223 313131 Fax: 01223 313131</p>
--