SE/100364/F

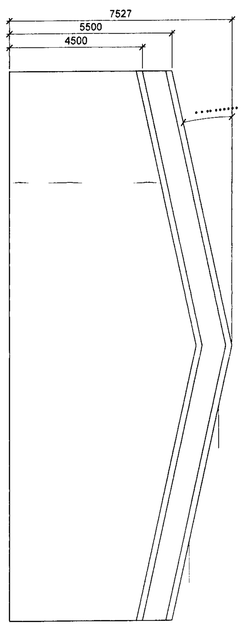

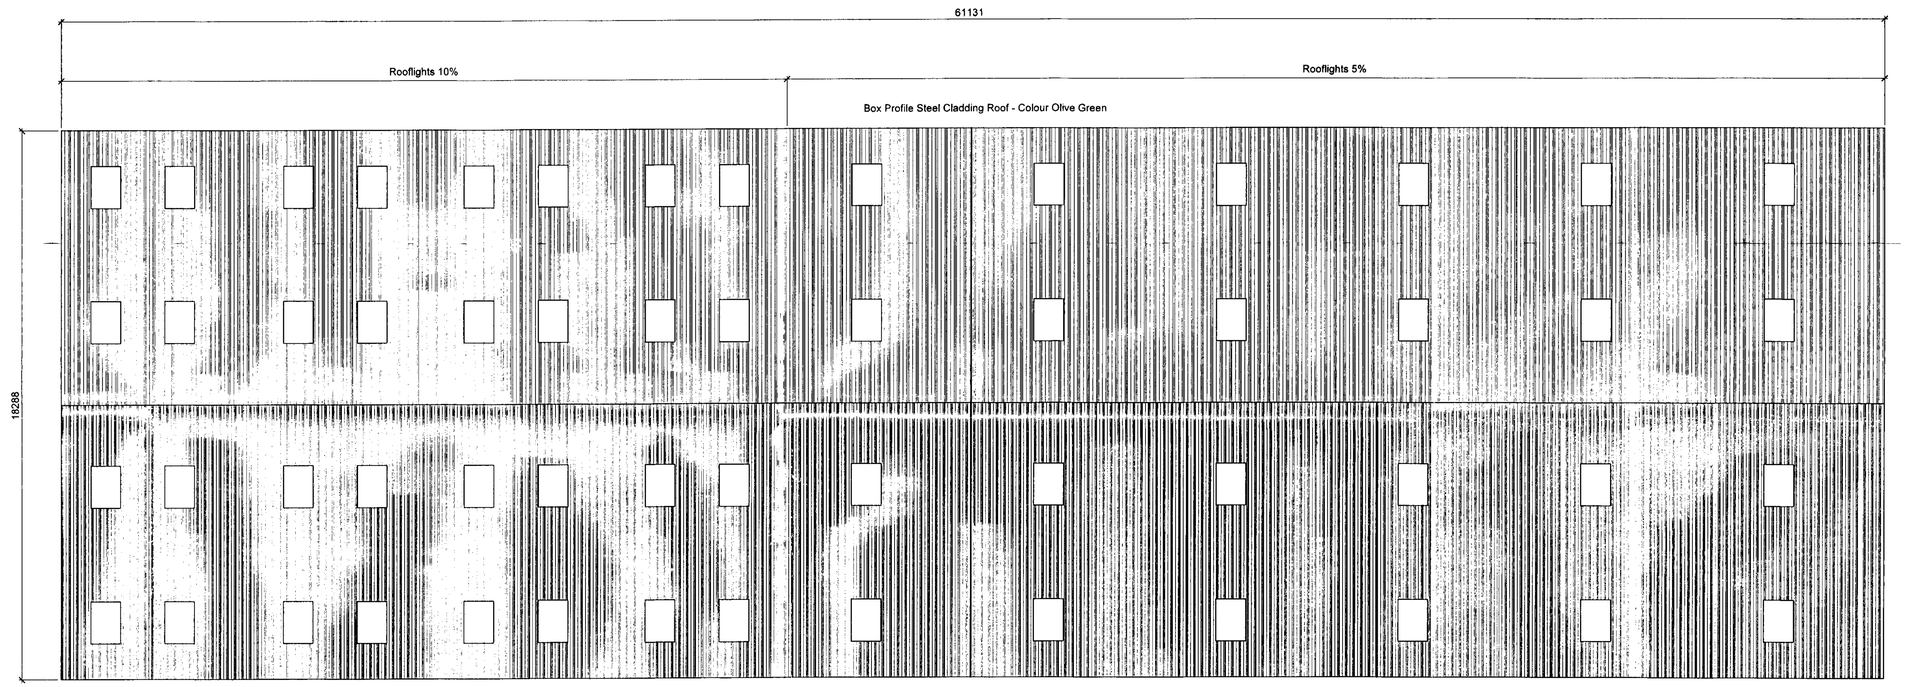

Paper Size			
A1	Surface Water 150mm Surface Water 225mm Surface Water 300mm Surface Water 450mm Foul Sewer 100mm Foul Sewer 150mm	Electricity Supply Gas Supply (GAS) Mains Water 63mm Mains Water 32mm High Pressure Water Telecom's	1 100mm Ducts 2 100mm Ducts 3 100mm Ducts 4 100mm Ducts Surface Water Slotted Drain 225mm

Rev No.	Revision Note.	Date	Drawn	Checked
B	Drains & Electrical Conduit added. Mods implemented	05/02/10	RGC	AW

THIS DRAWING IS COPYRIGHT. IT MUST NOT BE COPIED, USED OR DISCLOSED TO THIRD PARTIES WITHOUT PRIOR PERMISSION.

ALL DIMENSIONS TO BE CHECKED ON SITE PRIOR TO COMMENCEMENT.
ANY DISCREPANCIES TO BE BROUGHT TO THE ATTENTION OF DURSTON ABERT IMMEDIATELY.

ALL DRAWINGS TO BE READ IN STRICT CONJUNCTION WITH THE RELEVANT ENGINEERS DRAWINGS WHERE APPLICABLE. FULL APPROVAL OF ANY WORK AS STATED OR UNCOVERED TO BE OBTAINED BY EITHER CA OR LOCAL AUTHORITY BUILDING INSPECTOR.

ATSS
http://www.atssltd.com
Bourne Works
Collingbourne Ducis
Marlborough
Wilts, SN8 3EQ
Tel 01264 850446 - Email info@atssltd.com

Title	Drn by	Date	Chk by	Scale
Roof Plan	RGC	14.01.10	AW	1:100

Number - Rev - Client - Project: 01211-01 - B - Lower Cleeve Farm - Storage Building

Sheet: 02

19.2.2010 - Robert
Eurobuilder 97Exterior